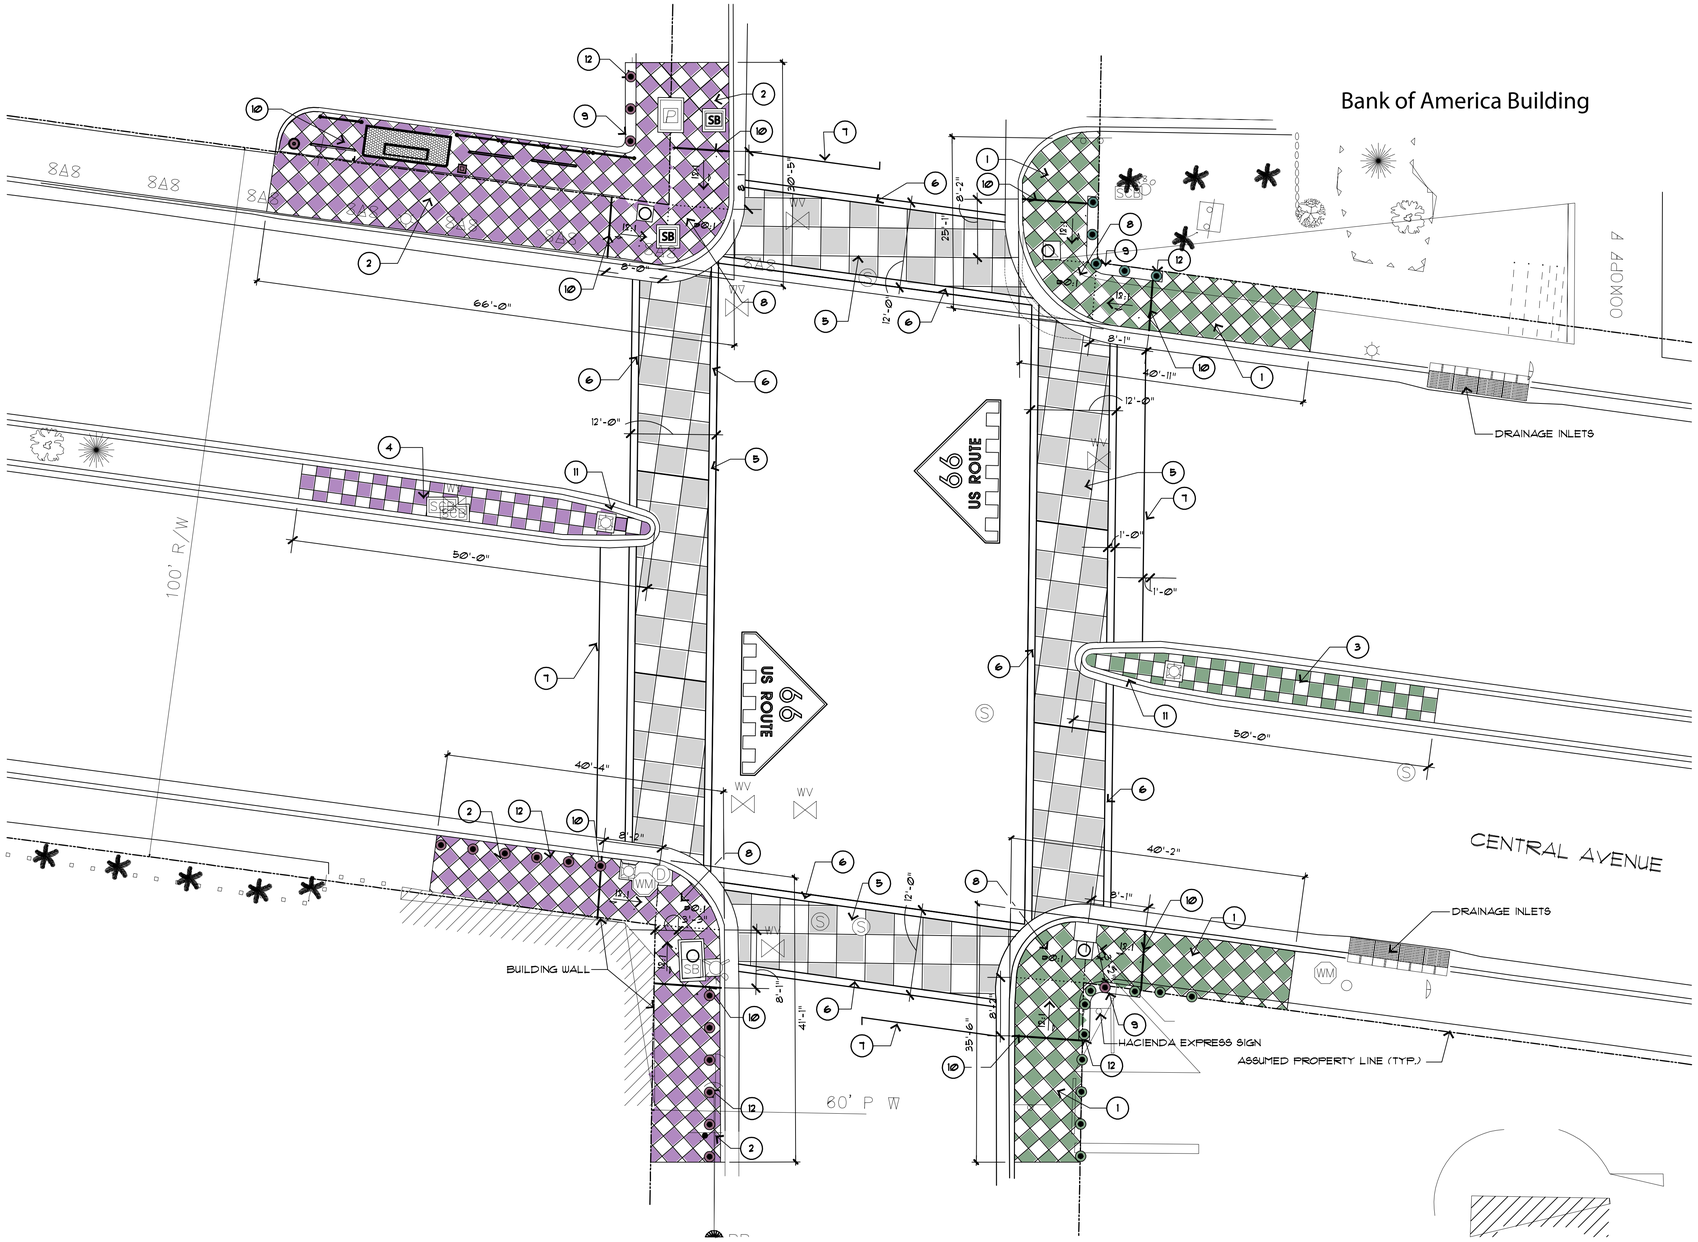

CONSTRUCTION NOTES

1. CONSTRUCT CONCRETE WALK. THE WALK SHALL BE 4" THICK, 4000 PSI, WHITE CONCRETE MIX. THE WALK SURFACE SHALL RECEIVE A MEDIUM BROOM FINISH PLACED PARALLEL TO THE DIAGONAL OF THE CONTROL JOINT GRID. CONTROL JOINTS SHALL BE 1" DEEP AND SHALL BE SAW CUT IN A 2'x2' GRID PATTERN AS SHOWN ON THE PLAN. ALTERNATE SQUARES, AS CREATED BY THE CONTROL JOINT PATTERN, SHALL BE STAINED WITH QC PATINA STAIN, IC-5, MARINA GREEN, AS MANUFACTURED BY QC CONSTRUCTION PRODUCTS OR EQUAL. REFERENCE THE NOTES.
2. CONSTRUCT CONCRETE WALK. THE WALK SHALL BE 4" THICK, 4000 PSI, WHITE CONCRETE MIX. THE WALK SURFACE SHALL RECEIVE A MEDIUM BROOM FINISH PLACED PARALLEL TO THE DIAGONAL OF THE CONTROL JOINT GRID. CONTROL JOINTS SHALL BE 1" DEEP AND SHALL BE SAW CUT IN A 2'x2' GRID PATTERN AS SHOWN ON THE PLAN. ALTERNATE SQUARES, AS CREATED BY THE CONTROL JOINT PATTERN, SHALL BE STAINED WITH QC PATINA STAIN, IC-4, PURPLE DAWN, AS MANUFACTURED BY QC CONSTRUCTION PRODUCTS OR EQUAL. REFERENCE THE NOTES.
3. CONSTRUCT CONCRETE MEDIAN PAVING. THE MEDIAN PAVING SHALL BE 4" THICK, 4000 PSI, WHITE CONCRETE MIX. THE CONCRETE SURFACE SHALL RECEIVE A MEDIUM BROOM FINISH PLACED PARALLEL TO THE SAW CUT IN THE NORTH-SOUTH DIRECTION. CONTROL JOINTS SHALL BE 1" DEEP AND SHALL BE SAW CUT IN A 2'x2' GRID PATTERN AS SHOWN ON THE PLAN. ALTERNATE SQUARES, AS CREATED BY THE CONTROL JOINT PATTERN, SHALL BE STAINED WITH QC PATINA STAIN, IC-5, MARINA GREEN, AS MANUFACTURED BY QC CONSTRUCTION PRODUCTS OR EQUAL. REFERENCE THE NOTES.
4. CONSTRUCT CONCRETE MEDIAN PAVING. THE MEDIAN PAVING SHALL BE 4" THICK, 4000 PSI, WHITE CONCRETE MIX. THE CONCRETE SURFACE SHALL RECEIVE A MEDIUM BROOM FINISH PLACED PARALLEL TO THE SAW CUT IN THE NORTH-SOUTH DIRECTION. CONTROL JOINTS SHALL BE 1" DEEP AND SHALL BE SAW CUT IN A 2'x2' GRID PATTERN AS SHOWN ON THE PLAN. ALTERNATE SQUARES, AS CREATED BY THE CONTROL JOINT PATTERN, SHALL BE STAINED WITH QC PATINA STAIN, IC-5, PURPLE DAWN, AS MANUFACTURED BY QC CONSTRUCTION PRODUCTS OR EQUAL. REFERENCE THE NOTES.
5. CONSTRUCT CONCRETE CROSSWALK. THE CROSSWALK SHALL BE 6" THICK, 4000 PSI, CITY STANDARD CONCRETE MIX OVER 6" ASPHALT OR CEMENT TREATED BASE COURSE COMPACTED TO 95%. TOOL JOINTS SHALL BE PLACED IN A 4'x4' GRID PATTERN AS SHOWN ON THE PLAN. THE CROSSWALK SURFACE SHALL RECEIVE A HEAVY BROOM FINISH WITH THE DIRECTION OF BROOM FINISH ALTERNATING EVERY OTHER SQUARE. EACH SQUARE IN THE GRID SHALL THEN RECEIVE A 4" SMOOTH TROWEL EDGE. REFERENCE DETAIL .... AND C.O.A. STD. DWG. 2407.
6. WHITE REFLECTORIZED TAPE, 12" WIDE, SHALL BE APPLIED TO THE 12" WIDE CONCRETE EDGES ON EACH SIDE OF THE CROSSWALK AS SHOWN ON THE PLAN.
7. WHITE REFLECTORIZED TAPE, 24" WIDE, SHALL BE APPLIED TO THE ASPHALT TO PROVIDE A STOP BAR LOCATED 4'-0" FROM THE CROSSWALK AS SHOWN ON THE PLAN.
8. CONSTRUCT HANDICAP RAMPS AS SHOWN. TOP OF ADJACENT CURBS SHALL BE FLUSH WITH TOP OF RAMP.
9. CONSTRUCT HEADER CURB AT BACK EDGE OF HANDICAP RAMP AS SHOWN. THE CURB SHALL BE PLACED AFTER FLATWORK IS COMPLETED.
10. EXPANSION JOINT TO BE PLACED AT GRID CORNER INTERSECTIONS AS SHOWN ON THE PLAN.
11. PAINT MEDIAN NOSE WITH 2 COATS YELLOW TRAFFIC PAINT.
12. DECORATIVE BOLLARDS. SEE DETAIL -- SHEET 4.

NOTES

1. CONCRETE CONTROL JOINTS TO BE PLACED 10'-0" O.C. WITH EXPANSION JOINTS 20'-0" O.C. AND WHERE CONCRETE ABUTS STRUCTURES OR CURBS.
2. EXPANSION MATERIAL SHALL CONFORM SMOOTHLY TO SHAPE OF ADJACENT FIXED OBJECT.
3. TOP OF ALL CONCRETE FLAT WORK SHALL BE CONSTRUCTED FLUSH WITH TOP OF ADJACENT CURB.
4. ALL CONCRETE WORK TO BE CONSTRUCTED PER C.O.A. STANDARD DETAILS AND SPECIFICATIONS EXCEPT WHERE OTHERWISE NOTED.
5. THE WHITE CONCRETE SHALL CONFORM TO THE CITY OF ALBUQUERQUE STANDARD SPECIFICATION FOR PORTLAND CEMENT CONCRETE, SECTION 101. WHITE PORTLAND CEMENT SHALL BE SUBSTITUTED FOR THE STANDARD PORTLAND CEMENT. ALL OTHER REQUIREMENTS OF THE SPECIFICATIONS REMAIN AS STATED.
6. THE SAW CUT CONTROL JOINTS SHALL BE MADE 24 HOURS AFTER PLACEMENT OF CONCRETE.
7. THE SAW CUT SHALL RUN CONTINUOUS FROM EDGE TO EDGE OF WALK WITHOUT CUTTING OR MARKING ADJACENT CURBS.
8. DO NOT USE CURING COMPOUNDS OR PLASTIC SHEETING TO CURE THE CONCRETE. THE ENTIRE SURFACE OF ALL CONCRETE SHALL BE CURED IN A CONSISTENT MANNER.
9. CONCRETE STAIN SHALL NOT BE APPLIED UNTIL THE CONCRETE HAS CURED FOR A FULL 28 DAYS.
10. THE CONTRACTOR SHALL FOLLOW THE MANUFACTURER'S DIRECTIONS IN APPLICATION OF ALL CONCRETE STAIN.

SURVEY INFORMATION
FIELD NOTES

NO.	BY	DATE

BENCH MARKS

AS BUILT INFORMATION
CONTRACTOR
WORK STARTED BY — DATE
INSPECTORS ACCEPTANCE BY — DATE
VERIFICATION BY — DATE
DRAWINGS CORRECTED BY — DATE

MICRO-FILM INFORMATION
RECORDED BY — DATE
NO.

ENGINEER'S SEAL

NO.	DATE	REMARKS	BY
		REVISIONS	
		DESIGN	
		DESIGNED BY x	DATE x
		DRAWN BY x	DATE x
		CHECKED BY x	DATE x

STATE OF NEW MEXICO
BAKER H. MORROW NO. 2
REGISTERED LANDSCAPE ARCHITECT

MORROW REARDON WILKINSON, LTD., LANDSCAPE ARCHITECTS
210 La Veta NE, Albuquerque, NM 87108
505.268.2266 FAX 505.265.9637
mrw@mrwnm.com

CITY OF ALBUQUERQUE
CAPITAL IMPLEMENTATION PROGRAM

TITLE: WASHINGTON AND CENTRAL AVENUE INTERSECTION IMPROVEMENTS CONSTRUCTION PLAN

Design Review Committee	City Engineer Approval	Last Design Updates	Mo/Day/yr.	Mo/Day/yr.

CITY PROJECT NO.	ZONE MAP NO.	SHEET	OF
682491	K-17-Z	3	6

P:\PERSONAL FOLDERS\PAT'S WORK FILES\washcentral.dwg, 10/28/02 10:05:17 AM, 1:1